



1", 1-1/2", OR 2"
WATER SERVICES:

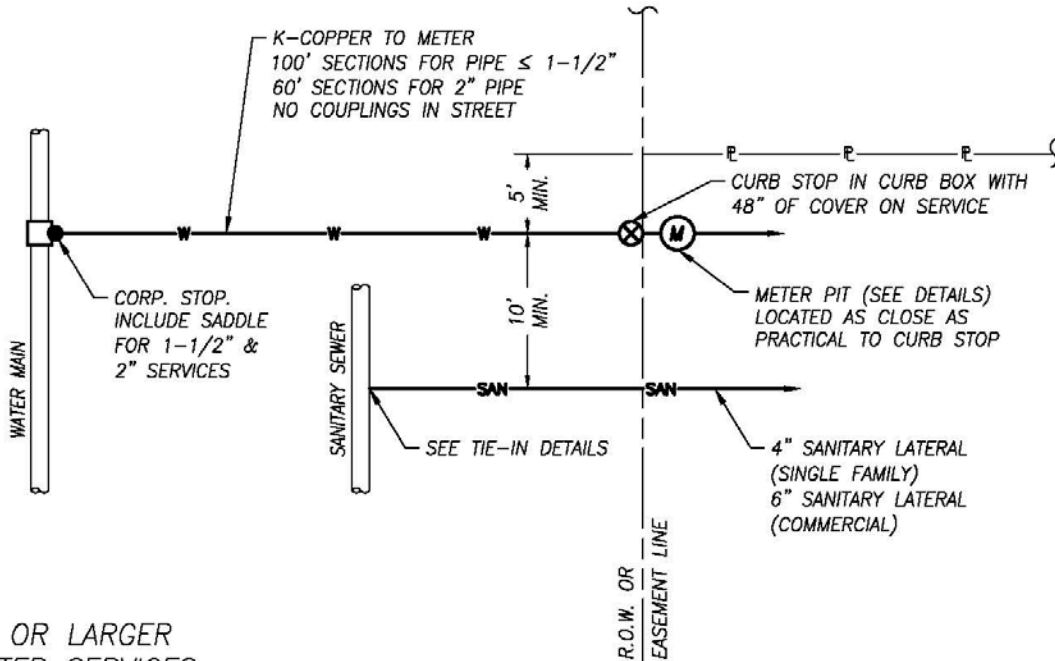

3" OR LARGER
WATER SERVICES:

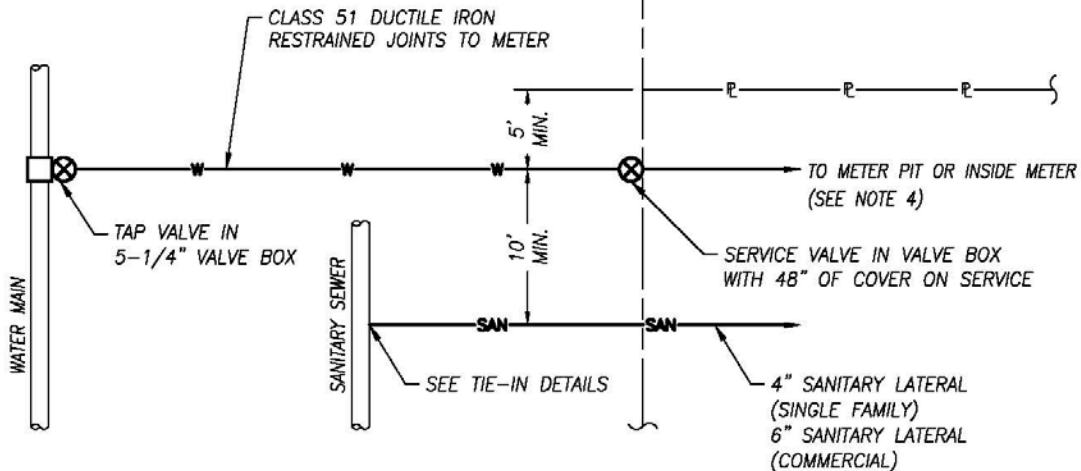

NOTES:

1. CONTACT MCES FOR COURSE OF ACTION FOR ANY SITUATION NOT COVERED IN HANDBOOK
2. SHUTOFF VALVE REQUIRED IMMEDIATELY AFTER SERVICE ENTERS BUILDING
3. PICKUP OF 3/4" SERVICE IS ONLY PERMITTED IF K-COPPER AND EXISTING STUB WERE INSTALLED AS PART OF A MAIN LINE EXTENSION
4. INSIDE METER MUST MEET ALL REQUIREMENTS PER MCES RULES AND REGULATIONS

MONTGOMERY COUNTY
ENVIRONMENTAL SERVICES



TYPICAL SERVICE
INSTALLATION

SCALE : NONE

DATE : 11/21/2019